


LINE 3P+N+T 400V 50Hz

MASTERARIA MAXI



CAREL Applico

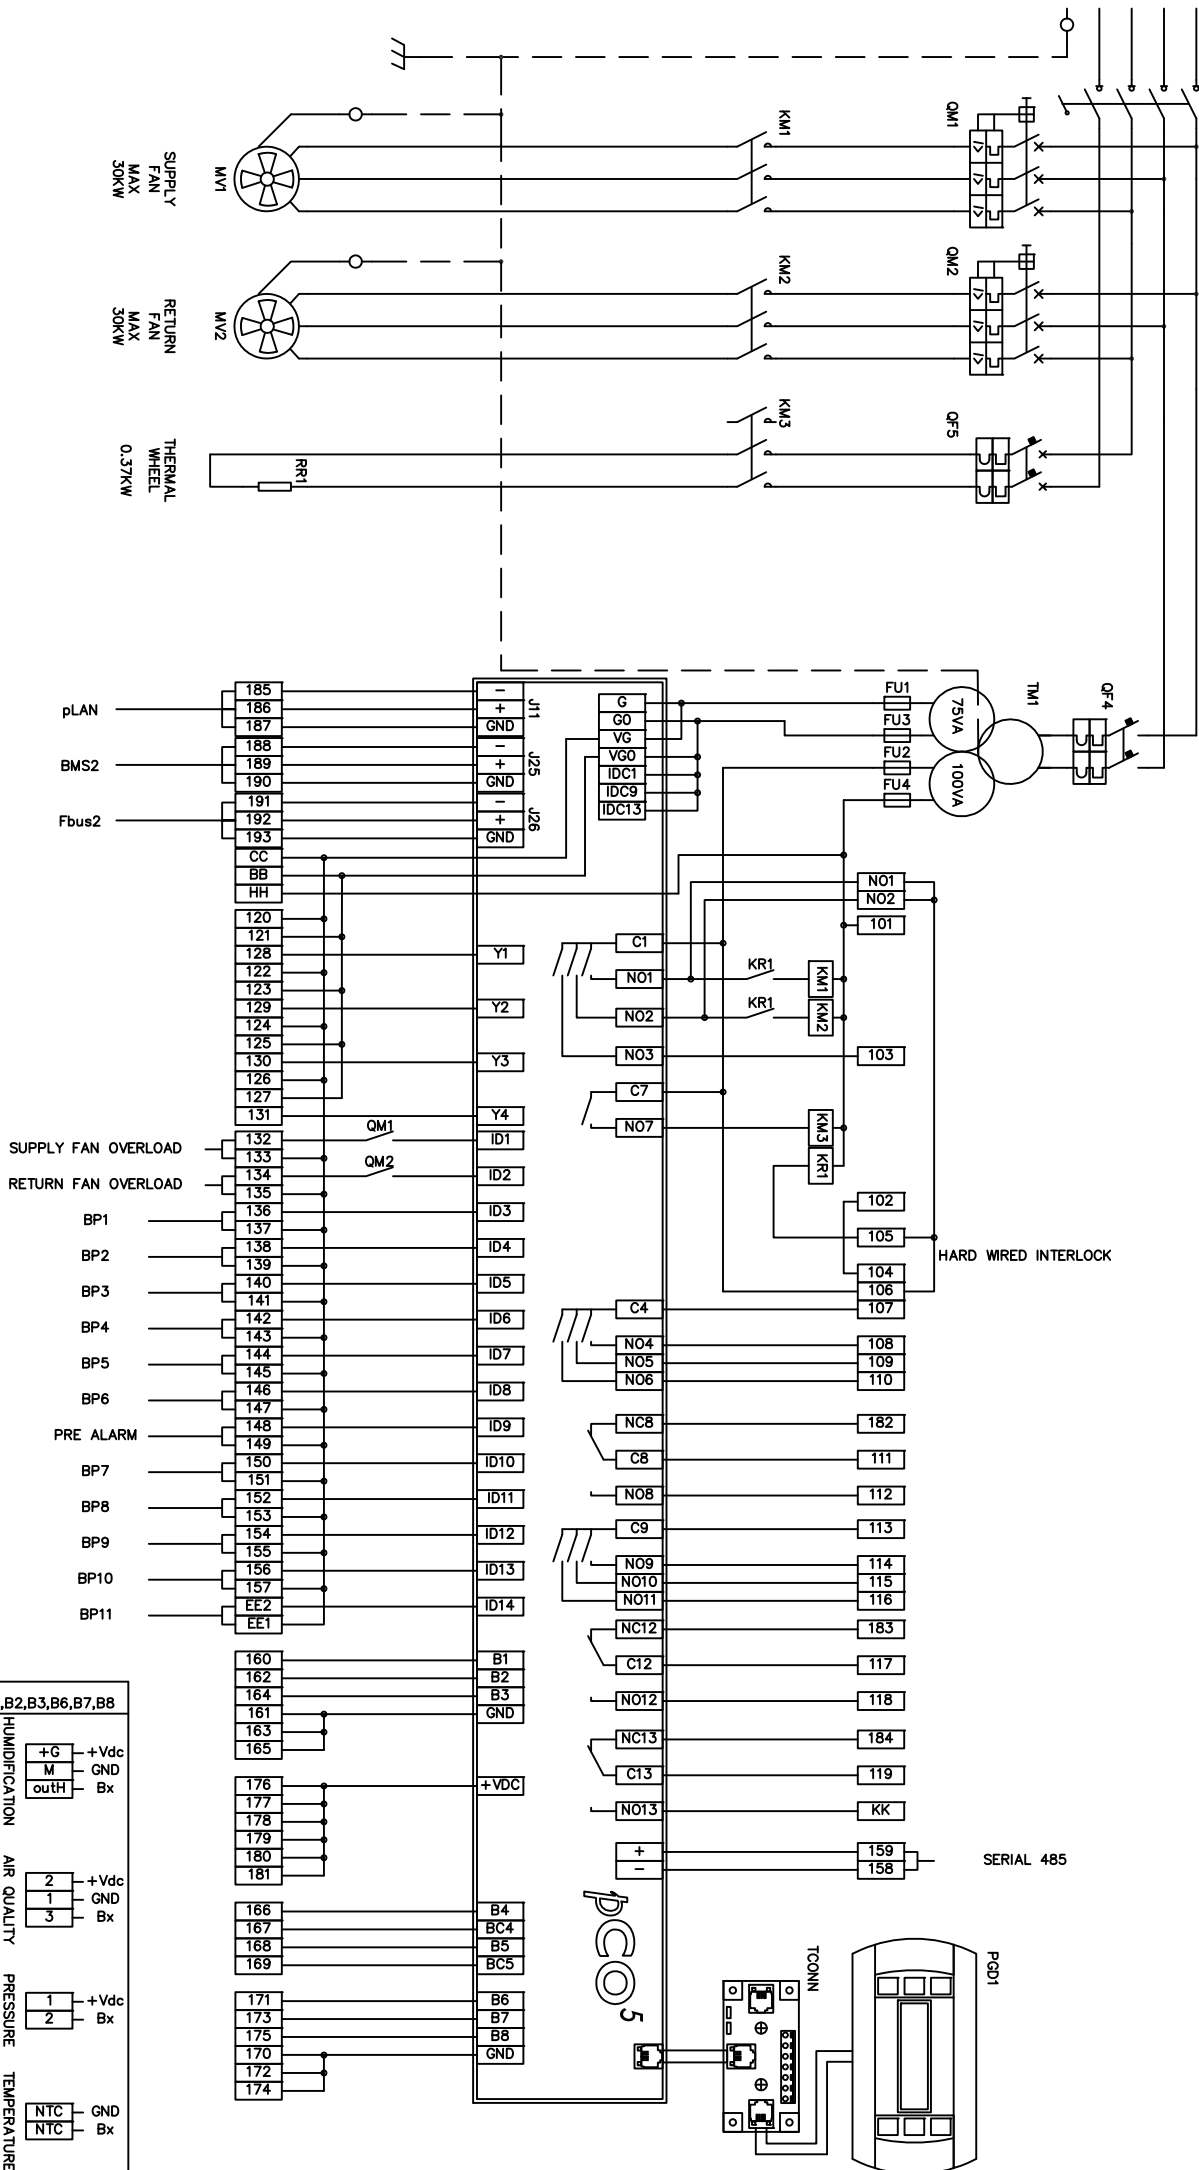

CM00003538 DEL 10/05/2012

B4,B5	B1,B2,B3,B6,B7,B8
TEMPERATURE SENSOR	HUMIDIFICATION SENSOR
NTC	+G +Vdc
NTC	M GND
	outh Bx
	AIR QUALITY DPDA402000
	2 +Vdc
	1 GND
	3 Bx
	PRESSURE
	1 +Vdc
	2 Bx
	TEMPERATURE SENSOR
	NTC
	NTC
	GND
	Bx